

**INSTALLATION INSTRUCTIONS
PNEUMATIC TIME DELAY SWITCH
MODELS TS-15, TS-16**



UL FILE SA32686

WIRING		
Wire Color	Designation	Notes
Red	N/C Contacts	Contacts rated 2A @ 28VDC
Blue	N/O Contacts	

Mounting -


Unit should be mounted in a vertical position in a 2.5" deep electrical box.

Time Adjustment -

Rotate knob clockwise for maximum time (60 seconds).

Rotate knob counter clockwise for minimum time (2 seconds).

Note: Switch time repeatability is $\pm 10\%$.

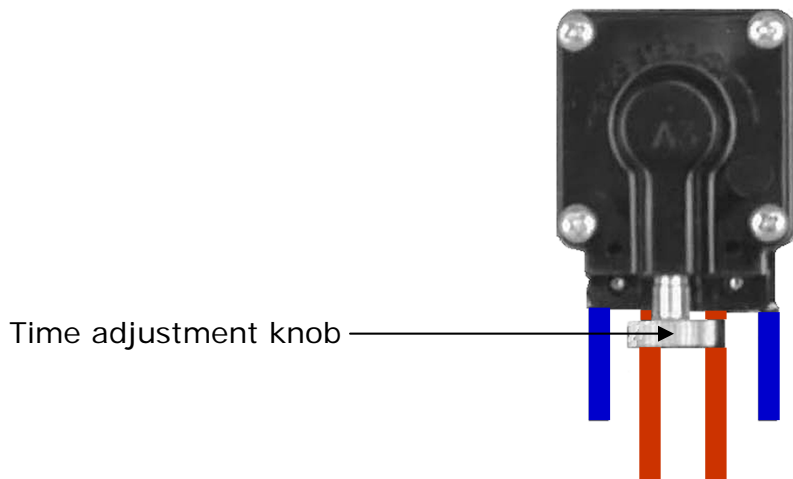

Alarm Controls
19 Brandywine Drive
Deer Park, New York 11729
(800) 645-5538
www.alarmcontrols.com